

STATIONARY BATTERY INSTALLATION AND OPERATING INSTRUCTIONS

4-1034

DANGER Lead Acid Battery Contains: Lead, Sulfuric Acid (Electrolyte), Lead Compounds.

Harmful if swallowed, inhaled, or in contact with skin.
 Acid causes severe skin burns and eye damage.
 May damage fertility or the unborn child if ingested or inhaled.
 May cause harm to breast-fed children.
 May cause cancer if ingested or inhaled.
 Causes skin irritation, serious eye damage.
 Contact with internal components may cause irritation or severe burns.
 Causes damage to central nervous system, blood and kidneys through prolonged or repeated exposure if ingested or inhaled.
 Irritating to eyes, respiratory system, and skin.
 May form explosive air/gas mixture during charging.
 Extremely flammable gas (hydrogen). Explosive, fire, blast or projection hazard.
 Obtain special instructions before use.
 Do not handle until all safety precautions have been read and understood.
 Wash thoroughly after handling.
 Do not eat drink or smoke when using this product.
 Avoid contact during pregnancy/while nursing.

Wear protective gloves/protective clothing, eye protection/face protection. Use only outdoors or in a well-ventilated area.
 Avoid contact with internal acid.
 Do not breathe dust/fume/gas/mist/vapors/spray.
 Keep away from heat/sparks/open flames/hot surfaces. No smoking.
 IF SWALLOWED OR CONSUMED: rinse mouth. Do NOT induce vomiting.
 Call a poison center/doctor if you feel unwell.
 IF ON CLOTHING OR SKIN (or hair): Remove/Take off immediately all contaminated clothing and wash it before reuse. Rinse skin with water/shower.
 IF INHALED: Remove person to fresh air and keep comfortable for breathing. Immediately call a POISON CENTER or doctor/physician.
 IF IN EYES: Rinse cautiously with water for several minutes. Remove contact lenses, if present and easy to do. Continue rinsing.
 If exposed/concerned, or if you feel unwell seek medical attention/advise.
 Store locked up, in a well-ventilated area, in accordance with local and national regulation.
 Dispose of contents/container in accordance with local and national regulation.
 Keep out of reach of children.

PROPOSITION 65 WARNING: battery posts, terminals and related accessories contain lead and lead compounds, chemicals known to the State of California to cause cancer and reproductive harm. Batteries also contain other chemicals known to the State of California to cause cancer. **WASH HANDS AFTER HANDLING.**

WARNING: Risk of fire, explosion or burns. Do not disassemble or incinerate. Not recommended for inverted use. **High Voltage:** Risk of shock. Do not touch uninsulated terminals or connectors.

Do Not Remove Vent Valve

Manufactured by: East Penn Manufacturing Co.
102 Deka Road, Lyon Station, PA 19536 USA 610-682-6361 **Lead Acid Battery Electrolyte (Sulfuric Acid)**

BATTERIES AND OTHER RELATED PARTS CONTAIN LEAD

WARNING:
 Battery posts, terminals and related accessories contain lead and lead compounds, chemicals known to the State of California to cause cancer and reproductive harm.
 Batteries also contain other chemicals known to the State of California to cause cancer.
WASH HANDS AFTER HANDLING!

Form No. 1214 Rev. 8/02. Must be posted on available near battery.

For Energy Storage applications following UL 1973 requirements Appendix A must be reviewed.

IN REFERENCE TO THIS MANUAL:

- **“Battery” is defined as an individual 12-volt unit.**
- **“Battery string” is defined as a series connected electrical system comprised of batteries (individual 12-volt units).**

SAFETY PRECAUTIONS

Although all valve regulated batteries have the electrolyte immobilized within the battery, the electrical hazard associated with batteries still exists. **Work performed on these batteries should be done with the tools and the protective equipment listed below.** VRLA battery installations should be supervised by personnel familiar with batteries and battery safety precautions.

WARNING: Risk of fire, explosion or burns. Do not disassemble, heat above 65°C, or incinerate.

Protective Equipment

Although VRLA batteries can vent or leak small amounts of electrolyte, electrical safety is the principle but not the only concern for safe handling. Per IEEE 1188 recommendations, the following minimum set of equipment for safe handling of the battery and protection of personnel shall be available:

1. Safety glasses with side shields, or goggles, or face shields as appropriate. (Consult application specific requirements)
2. Electrically insulated gloves, appropriate for the installation.
3. Protective aprons and safety shoes.
4. Portable or stationary water facilities in the battery vicinity for rinsing eyes and skin in case of contact with acid electrolyte.
5. Class C fire extinguisher.
6. Acid neutralizing agent.

Protective Equipment *cont.*

7. Adequately insulated tools (as defined by ASTM F1505 “Standard Specification for Insulated and Insulating Hand Tools”).
8. Lifting devices of adequate capacity, when required.

Procedures

The following safety procedures should be followed:

Always wear safety glasses or face shield when working on or near batteries.

1. These batteries are sealed and contain no free electrolyte. Under normal operating conditions, they do not present any acid danger. However, if the battery case or cover is damaged, acid could be present. **Sulfuric acid is harmful to the skin and eyes. Flush affected area with water immediately and consult a physician if splashed in the eyes. Consult SDS for additional precautions and first aid measures.**
SDS sheets can be obtained at www.eastpennmanufacturing.com
2. **Prohibit smoking and open flames, and avoid arcing in the immediate vicinity of the battery.**
3. Do not wear metallic objects, such as jewelry, while working on batteries. Do not store un-insulated tools in pockets or tool belt while working in vicinity of battery.
4. Keep the top of the battery dry and clear of tools and other foreign objects.
5. Provide adequate ventilation (per **IEEE standard 1187 and/or local codes**) and follow recommended charging voltages.
6. **Never remove or tamper with the pressure relief valves. Warranty void if vent valve is removed.**
7. Inspect all flooring and lifting equipment for functional adequacy.
8. Adequately secure battery modules, racks, or cabinets to the floor.
9. Connect support structures to ground system in accordance with applicable codes.
10. The below IEEE Standards contain additional information. Other standards may be relevant to your specific application.
IEEE 1184 – Guide for Batteries for UPS Systems
IEEE 1187 – Recommended Practice for Installation Design of VRLA Batteries
IEEE 1188 – Recommended Practice for Maintenance, Testing, of VRLA Batteries
IEEE 1189 – Selection of VRLA Batteries for Stationary Applications

RECEIVING & STORAGE

Receiving Inspection

Upon receipt, and at the time of actual unloading, each package should be visually inspected for any possible damage or electrolyte leakage. If either the entire shipment should be conducted and noted on the bill of lading. Record receipt date, inspection date and notify carrier of any damage.

Original packaging should remain on battery during storage and transportation to prevent damage to the battery or short circuit of the terminals”

Unpacking

1. **Always wear eye protection.**
2. Check all batteries for visible defects such as cracked containers, loose terminal posts, or other unrepairable problems. Batteries with these defects must be replaced.
3. Check the contents of the packages against the packaging list. Report any missing parts or shipping damage to your East Penn agent or East Penn Mfg. Co. immediately.
4. Never lift batteries by the terminal posts.

Storage / Refresh

Batteries should be installed, and float charged upon delivery. If batteries are to be stored, the below requirements shall be followed.

1. Batteries shall be stored indoors in a clean, level, dry, cool location.
2. Store, charge, and ship in vertical position only.
3. Battery pallets shall not be double stacked, or equipment stored on top.
4. Recommended storage temperature is 50°F (10°C) to 77°F (25°C). Acceptable storage temperature is 0°F (-18°C) to 90°F (32°C).
5. The batteries shall be given a refresh charge at regular intervals as detailed below:
0°F(-18°C) to 77°F (25°C)
Batteries shall be charged by the “battery charge date” marked on pallet. Successive recharges shall be performed every 6 months.
78°F (26°C) to 90°F (32°C)
Battery voltage readings shall be taken monthly. Batteries must be given a refresh charge within 3 months from date of receipt or if any battery voltage falls below 12.72 volts per battery, whichever occurs first. Successive refresh charges shall be performed every 3 months.
6. Whenever a refresh charge is required, it's important that all batteries to be installed in the same series string receive a charge at the same time to ensure continuity once placed in their intended application.

Storage / Refresh *cont.*

7. Each battery shall be charged for 24 hours at a constant voltage equal to 14.40 volts per battery. To ensure the batteries are fully charged within 24hrs, the charger used for this refresh charge must have the capacity to provide at least the minimum charge current specification and not exceed the maximum charge current for the given battery type (model), as called out in Appendix D.
8. All requested information on “Refresh Record Form” in Appendix B should be completed for each refresh charge.
9. Batteries shall not be stored beyond 12 months. Storing beyond 12 months will affect warranty.
10. If the storage / refresh requirements cannot be met, contact the East Penn Reserve Power Product Support Department for alternate instructions.

INSTALLATION

General

Caution should be taken when installing batteries to insure no damage occurs. The battery string cabinet, tray, rack, etc. shall be inspected for sharp edges that could cause damage to the battery casing. Batteries shall not be dropped, slid, or placed on rough or uneven surfaces such as tray lips or grated flooring. Mishandling of batteries could result in equipment damage or human injury. East Penn will not be liable for damage or injury as a result of mishandling or misuse of the product.

NOTE: If battery monitoring system is installed prior to battery being placed in service; monitoring system should remain off to prevent discharging of battery.

Electrical Connections

When making electrical connections to the battery string, proper techniques should be applied per electrical standards such as NEC and/or Federal, State and Local codes, as well as User Manual of specific application.

Grounding

When grounding the battery string, proper techniques should be applied per electrical standards such as NEC and/or Federal, State and Local codes, as well as User Manual of specific application.

Cabinets


Cabinet systems come factory assembled and prewired. Do not tip or turn cabinets on their sides when positioning them in their intended installation area. Cabinets must be used in an upright position. These systems are pre-connected. Only inter-shelf, inter-cabinet and connections to the load are required. See the connection diagram inside the cabinet. Inter-cabinet and load connection cables are not included.

Racks

Assemble racks in accordance with the intended arrangement, align with a level and bolt to the floor. See rack assembly instructions.


DEKA UNIGY I BATTERIES ARE TESTED AND APPROVED TO BE INSTALLED AND OPERATED IN THEIR UPRIGHT POSITION.

TOP TERMINAL BATTERY

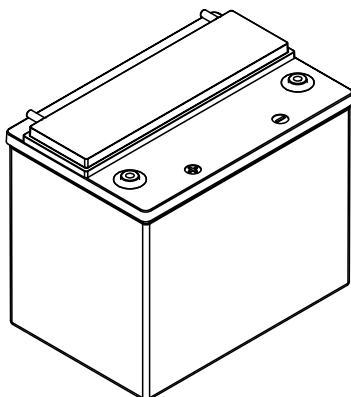

Terminals – Upright Position

FRONT TERMINAL BATTERY

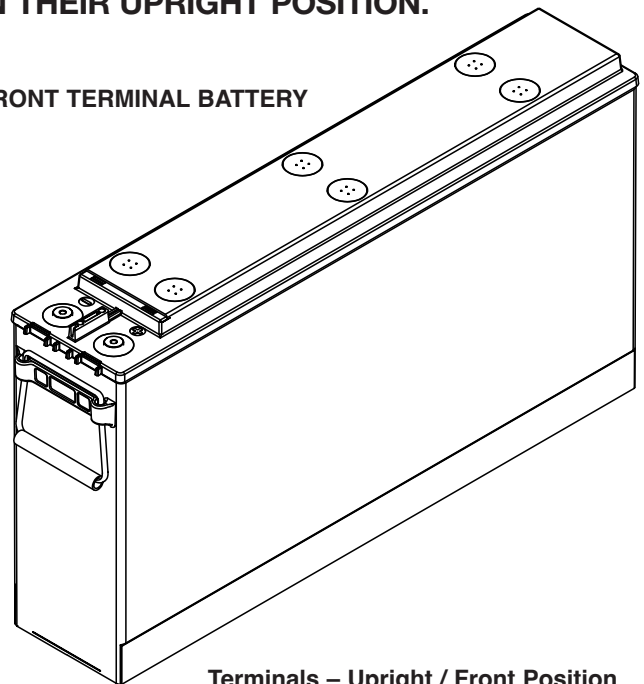

Terminals – Upright / Front Position

FOR ANY OTHER INSTALLATION ORIENTATION, THE PRODUCT WILL NOT BE WARRANTED.

Venting

Under normal operation, VRLA batteries emit hydrogen gas, which is combustible at certain concentrations. Proper ventilation should be provided per IEEE 1187 and/or local codes. Some batteries are designed to accommodate the use of vent tubing. Ventilation equipment is not designed or supplied by East Penn Mfg.

Safe installation of any venting equipment is the responsibility of the installer.

BATTERY ASSEMBLY

(ALWAYS WEAR EYE PROTECTION.)

1. Set up the battery string so that the positive post (+) of one battery is connected to the negative post (-) of the next battery for all series connections. The interbattery connector contact surfaces shall be cleaned by rubbing gently with a non-metallic brush or pad before installing connectors.
Only approved oxide inhibitors (No-Ox-ID "A" from Sanchem, Inc.) may be applied to connections or battery posts.
2. For future identification, individual batteries should be numbered in electrical connection sequence, beginning with number one (1) at the positive end of the battery string.
3. Install all interbattery connectors using lock washer and bolts loosely to allow for final alignment of batteries, then torque to 100 in lb +/- 5. After torquing the connections on racked batteries, read the voltage of the battery string to assure that individual batteries are connected correctly. The total voltage should be approximately equal to the number of batteries times the measured voltage of one battery (when connected in series). If the measurement is less, recheck the connections for proper voltage and polarity.
4. Read and record interbattery connection resistance and note the method of measurement. This helps determine a satisfactory initial installation and can be used as a reference for future maintenance requirements. **See Battery Maintenance Report. (Pg. 10 – Appendix E).** Clean, remake and re-measure any connection having a resistance measurement greater than 10% of the average of all the same type of connections (interbattery, inter-tier or shelf, inter-rack or intercabinet).
5. Battery performance is based on the output at the battery terminals. Therefore, the shortest electrical connections between the battery string and the operating equipment results in maximum total battery string performance.

Do not select cable size on current carrying capability only. Cable size should not provide a greater voltage drop between the battery system and operating equipment than specified. Excess voltage drop will reduce the desired support time of the battery system.

SYSTEM OPERATIONS

Charger Voltage

These batteries are designed for continuous float applications.

FLOAT / STANDBY (per battery)

13.50V +/- 0.5% @ 77°F (25°C)

When setting the float voltage on the charger, the battery string should be set to float at the nominal battery float voltage times the number of batteries in the string. The charger must be able to maintain the system voltage within $\pm 0.5\%$ of the desired level at all times.

Example: For a 48V system, the float voltage may vary from 53.73V to 54.27V

TEMPERATURE COMPENSATION

Battery voltage should be adjusted for ambient temperature variations.

12mV per °C (1.8°F) per 12V battery

Consult Voltage Compensation Chart (Pg. 9 – Appendix C) for temperature compensation voltage maximum and minimum limits.

Charger Current

Charge current should not exceed the recommended min. and max. requirements. Consult **Appendix D** for min. and max. charge current limits.

Battery Voltage

Individual battery voltages may vary by $\pm 0.30V$ per battery of the average battery string float voltage.

It is not unusual to observe a wide float voltage range between batteries for the first 6 months of operation. After the initial 6 months, an individual battery voltage of 12.90V or less while following the published float charge instructions indicates a potential problem and action should be taken to replace the low voltage unit.

Contact East Penn's Reserve Power Product Support Department at ReservePowerWarranty@dekabatteries.com for additional assistance.

Equalizing

Upon installation of the battery string, an optional charge of 14.40V per battery $\pm 0.5\%$ @ 77°F (25°C) for 24 hours (not to exceed 24 hours) can be applied. (NOTE: Verify that the higher battery voltage will not adversely affect any other connected equipment). **If this is done, be sure to reset the charging equipment to the proper float voltage upon completion of the equalize charge.**

Example: For a 48V system, the float voltage may vary from 57.31V to 57.89V

Battery Operation

Battery operating temperature will affect battery string capacity and operating life.

Temperatures greater than 77°F (25°C) will reduce the operating life of the battery. For every 13°F (7°C) increase in operating temperature above 77°F (25°C), the warranty period will be proportionally reduced by 50% as shown below:

The battery string operating temperature should not exceed 95°F (35°C) and should never exceed 105°F (40.5°C) for more than an eight-hour period. **If operating temperatures are expected to be in excess of 95°F (35°C), contact East Penn for recommendations.**

Operating Temperature		Proportional Percentage (%) of Life
°F	°C	
77	25	100%
81	27	80%
87	30	60%
90	32	50%

Discharging at temperatures less than 77°F (25°C) will reduce the capacity of the battery. **If operating temperatures are expected to be less than 50°F (10°C), contact East Penn for recommendations.**

The battery string must be located in a manner that the individual batteries do not vary by more than 5°F (2.8°C) between the lowest and highest individual battery temperatures.

NOTE: The battery system should not be discharged below published EOD (End of Discharge) ratings.

Rectifier Ripple Voltage

FREQUENCY

Ripple that has a frequency greater than 667Hz (duration less than 1.5ms) is acceptable, unless it is causing additional battery heating.

Ripple that has a frequency less than 667Hz (duration greater than 1.5ms), must meet the following voltage specification to be acceptable.

VOLTAGE SPECIFICATION

Ripple voltage shall be less than 0.5% peak to peak of the manufacturer's recommended battery string voltage.

Failure to comply can void the warranty.

RECORD KEEPING

Voltages, Temperatures & Ohmic READINGS

Record keeping is an important part of stationary battery maintenance and warranty coverage. This information will help in establishing a life history of the battery string and inform the user if and when corrective action needs to be taken. **Consult Battery Maintenance Report. (Pg. 10 – Appendix E).**

While it is acceptable to operate at temperatures less than 77°F (25°C), it will require longer charging time to become fully recharged. Also, the capacity will be less at operating temperatures below 77°F (25°C).

After installation and when the battery string has been on float charge for one week, the following data should be recorded:

1. Battery string voltage at battery terminals while battery is on float charge.
2. Charger voltage at charger panel meter.
3. Individual battery float voltages.
4. Ambient temperatures within area of battery string.
5. Terminal connections should be checked to verify that the installer did torque all connections properly to 100 in lb +/- 5. Micro-ohm readings should be taken across every connection. Refer to meter manufacturer's instructions for proper placement of probes. If any reading differs by more than 20% from its initial installation value, re-torque the connection to 100 in lb +/- 5. **If reading remains high, clean contact surfaces according to Step 1 under Battery Assembly.**

Failure to maintain proper records including information as detailed above may result in voiding any applicable warranty.

ACCEPTANCE / PERFORMANCE TESTING

An acceptance / performance test, if required can be performed upon initial installation to ensure the battery meets the initial requirements.

A performance test should be completed if, over the life of the battery, operation is questionable.

If an acceptance or performance test is required, follow the guidelines in Appendix F in conjunction with IEEE-1188.

MAINTENANCE

Always wear eye protection when working on or near batteries. Keep sparks and open flames away from batteries at all times. Review “Safety Precautions” (Pg. 1).

Annual Inspection⁽¹⁾

1. Conduct a visual inspection of each battery.
2. Record the battery string voltage at battery terminals while battery is on float charge.
3. Record the charger voltage at charger panel meter.
4. Record the individual battery voltages. The accuracy of the DMM (Digital Multimeter) must be 0.05% (on dc scale) or better. The DMM must be calibrated to NIST traceable standards. Because float readings are affected by discharge and recharges, these readings must be taken when the battery string has been on continuous, uninterrupted float for at least one month. Battery should be within ± 0.30 volts of the average battery string voltage.
5. Record the ambient temperatures.
6. Record the battery string temperature at the negative terminal.
7. Record individual battery Ohmic readings.
8. Record all interbattery and terminal connection resistances. Micro-ohm readings should be taken during this inspection. If any reading differs by more than 20% from initial readings taken, retorque the connection. Retorque value is equal to initial torque value as indicated in BATTERY ASSEMBLY section. Recheck the micro-ohm reading. If the reading remains high, clean the contact surface according to installation portion of this manual.

⁽¹⁾ Other Maintenance Inspection intervals follow IEEE 1188

Battery Cleaning

Do not use any chemical compounds to clean batteries. Batteries, cabinets, and racks, shall only be cleaned with: clear water, a mixture of baking soda and water or East Penn Mfg battery cleaner (part # 00321).

Any other types of chemical compounds or solvents other than listed above, to clean the battery may damage the battery case and / or cover causing possible exposure to sulfuric acid.

Capacity Testing

Per IEEE 1188 “Capacity testing is used to trend battery aging. The result of a capacity test is a calculation of the capacity of the battery. The calculated capacity is also used to determine if the battery requires replacement.”

When performing capacity testing and recording data refer to IEEE 1188 recommendations.

NOTE: When discharging at higher rates, extra connectors may need to be added to prevent excessive voltage drop and/or excessive temperature rise.

Should it be determined that only individual battery(ies) need to be replaced, contact East Penn.

APPENDIX A

For Energy Storage applications following UL 1973, the following shall be reviewed:


1. Batteries and components shall be installed in accordance with Article 480 or Article 706 of NFPA 70 or Section 64 of CSA C22.1.
2. The charger shall comply with one of the following standards: UL 1012, UL 1741, UL 60335-2-29/CSA C22.2 No. 60335-2-29, CAN/CSA C22.2 No. 107.2, or UL 62368-1/CSA C22.2 No. 62368-1
3. The charging system for these batteries shall prevent charging outside of the battery specifications through the use of voltage (and temperature for VRLA) monitoring and controls, or both current and temperature monitoring and controls. The system may also use current monitoring to prevent out of condition specifications.
4. If the batteries are being installed in a system greater than 60V, a disconnecting mean shall be provided for all ungrounded conductors in accordance with Article 480 of NFPA 70 or Section 64 of CSA C22.1.
5. Service disconnects shall be provided as applicable to the end product battery system in accordance with Article 480 of NFPA 70 or Section 64 of CSA C22.1.
6. Protection devices supplied with the battery should be installed prior to use. Consult electrical standards such as NEC and/or Federal, State and Local codes for additional protection device requirements, as well as User Manual of specific application.
7. The grounding and bonding system shall be checked after the completion of the assembly to ensure that the resistance is less than or equal to 0.1 Ω .
8. The maximum battery system voltage should not exceed a nominal 960 VDC. If this voltage is exceeded, a repeat of the dielectric voltage withstand test of the assembly of the higher voltage shall be performed.
9. To provide ample air circulation, a minimum spacing of 0.50" (12.7mm) should be between batteries. For top terminal batteries, a minimum of 4.00" (102 mm) is required between battery posts and any vertical framing. Electrical spacing requirements should be applied per electrical standards such as NEC and/or Federal, State and Local codes, as well as User Manual of specific application.
10. Minimum & maximum allowable operating range is -40°C (-40°F) to 40°C (104°F).
11. Minimum & maximum allowable discharge current to an end voltage of 10.50V (1.75 vpc) is listed below:

Unigy I - Minimum & Maximum Discharge Currents

Battery Type	Minimum Discharge Current	Maximum Discharge Current
	Amps	Amps
12AVR40	0.41	117
12AVR75	0.89	269
12AVR90	0.93	282
12AVR100	1.2	358
12AVR130	1.4	369
12AVR100ET	1.1	287
12AVR145ET	1.7	354
12AVR150ET	1.8	356
12AVR170ET	2.1	354
12AVR200ET	2.1	537

APPENDIX B

REFRESH RECORD FORM

	EPM Order Number*		Pallet ID Number		Individual Performing Test (Full Name)		Date of Refresh	Refresh Duration
	Information Prior to Refresh				Readings to be taken 1 hour before the completion of Refresh charging			
	Date Code	Battery Serial Number	Open Circuit Voltage		Battery Voltage Reading	Charging Current	Battery Temperature	Notes & Comments
Battery 1								
Battery 2								
Battery 3								
Battery 4								
Battery 5								
Battery 6								
Battery 7								
Battery 8								
Battery 9								
Battery 10								
Battery 11								
Battery 12								
Battery 13								
Battery 14								
Battery 15								
Battery 16								
Battery 17								
Battery 18								
Battery 19								
Battery 20								
Battery 21								
Battery 22								
Battery 23								
Battery 24								
Battery 25								
Battery 26								
Battery 27								
Battery 28								
Battery 29								
Battery 30								
Battery 31								
Battery 32								
Battery 33								
Battery 34								
Battery 35								
Battery 36								
Battery 37								
Battery 38								
Battery 39								
Battery 40								

ALL FIELDS TO THE RIGHT OF THE JAR NUMBER ABOVE MUST BE COMPLETED

EPM ORDER NUMBER WILL APPEAR ON THE SHIPPING LABEL ON THE CARTON COVERING EACH PALLET OF Batteries (if applicable)
 TO ENSURE CONTINUATION OF WARRANTY, SUBMIT FORMS TO: East Penn Mfg. Co, Inc., Reserve Power Division, Product Support & Warranty Dept. (reservepowerwarranty@dekabatteries.com)
 Electronic version of form can be obtained by contacting East Penn Mfg. Co, Inc., Reserve Power Division, Product Support & Warranty Dept. (reservepowerwarranty@dekabatteries.com)

APPENDIX C

VOLTAGE COMPENSATION CHART

°C	Float	Equalize	°F
>35	13.38	14.28	>95
34	13.39	14.29	93.2
33	13.40	14.30	91.4
32	13.42	14.32	89.6
31	13.43	14.33	87.8
30	13.44	14.34	86.0
29	13.45	14.35	84.2
28	13.46	14.36	82.4
27	13.48	14.38	80.6
26	13.49	14.39	78.8
25	13.50	14.40	77.0
24	13.51	14.41	75.2
23	13.52	14.42	73.4
22	13.54	14.44	71.6
21	13.55	14.45	69.8
20	13.56	14.46	68.0
19	13.57	14.47	66.2
18	13.58	14.48	64.4
17	13.60	14.50	62.6
16	13.61	14.51	60.8
15	13.62	14.52	59.0
14	13.63	14.53	57.2
13	13.64	14.54	55.4
12	13.66	14.56	53.6
11	13.67	14.57	51.8
<10	13.68	14.58	<50

12mV per °C

APPENDIX D

UNIGY I CHARGE CURRENT LIMITS

Battery Type	Max. Charge Current (A)	Min. Charge Current (A)**
12AVR40	6.7	2.0
12AVR75	13.4	4.0
12AVR90	15.5	4.7
12AVR100	17.9	5.4
12AVR130	23.6	7.1
12AVR100ET	17.6	5.3
12AVR145ET	26.3	7.9
12AVR150ET	27.1	8.1
12AVR170ET	30.8	9.3
12AVR200ET	38.3	11.5

** = Using minimum charge current will extend recharge time and increase risk of battery being undercharged



APPENDIX E

BATTERY MAINTENANCE REPORT

Inspection Date _____ No. of Units/String _____
 Company _____ Type _____
 Address _____ Date New _____
 Battery location and/or number _____ Date Installed _____

Individual Battery Readings

Charger Output _____ Amp Air Temperature _____ °F
 Total Battery String Voltage _____ Panel Meter Volts _____

Unit No.	Volts	Ohms or Mhos	Unit No.	Volts	Ohms or Mhos	Unit No.	Volts	Ohms or Mhos	Unit No.	Volts	Ohms or Mhos	Unit No.	Volts	Ohms or Mhos	Unit No.	Volts	Ohms or Mhos
1			41			81			121			161			201		
2			42			82			122			162			202		
3			43			83			123			163			203		
4			44			84			124			164			204		
5			45			85			125			165			205		
6			46			86			126			166			206		
7			47			87			127			167			207		
8			48			88			128			168			208		
9			49			89			129			169			209		
10			50			90			130			170			210		
11			51			91			131			171			211		
12			52			92			132			172			212		
13			53			93			133			173			213		
14			54			94			134			174			214		
15			55			95			135			175			215		
16			56			96			136			176			216		
17			57			97			137			177			217		
18			58			98			138			178			218		
19			59			99			139			179			219		
20			60			100			140			180			220		
21			61			101			141			181			221		
22			62			102			142			182			222		
23			63			103			142			183			223		
24			64			104			144			184			224		
25			65			105			145			185			225		
26			66			106			146			186			226		
27			67			107			147			187			227		
28			68			108			148			188			228		
29			69			109			149			189			229		
30			70			110			150			190			230		
31			71			111			151			191			231		
32			72			112			152			192			232		
33			73			113			153			193			233		
34			74			114			154			194			234		
35			75			115			155			195			235		
36			76			116			156			196			236		
37			77			117			157			197			237		
38			78			118			158			198			238		
39			79			119			159			199			239		
40			80			120			160			200			240		
Avg. Voltage		Avg. Voltage		Avg. Voltage		Avg. Voltage		Avg. Voltage		Avg. Voltage		Avg. Voltage		Avg. Voltage		Avg. Voltage	

Readings Taken By _____ Remarks/Recommendations _____

Readings should be taken at installation and annually thereafter.

APPENDIX F

ACCEPTANCE & PERFORMANCE TESTING

Each battery should be at 100% State of Charge prior to performing an acceptance or performance test on the battery system. To ensure the batteries are fully charged the following charge schedule should be followed.

1. Make sure all battery connections are clean, tight (i.e. – torqued to specification) and free of corrosion. Proper battery connections shall be verified via ohmic measurements between the connector and cell post.
2. Batteries should be charged at the equalization rate of 14.40 volts per battery for 24 hours. Temperature compensated charging parameters shall be applied as detailed in “Voltage Compensation Chart” in Appendix C of this manual.

To ensure the batteries are fully charged within 24hrs; the charger used for this equalizing charge must be sized to begin its charge with a charge current equal to at least the minimum, and not to exceed the maximum charge current for the given battery type (model), as called out in Appendix D of this manual. If multiple strings are to be charged simultaneously, the charge current requirement must be multiplied by the number of strings.

If these requirements cannot be met, contact East Penn Reserve Power’s Product Support Department for alternate instructions.

Upon completion, the charge voltage should be lowered to the float voltage of 13.50 volts per battery (6.75V for 6V battery) for a minimum period of 72 hours. Reference: IEEE 1188-2005 Section 7.2 for additional requirements.

Prior to completing the float charge, measure and record on charge battery voltages and individual battery ohmic values as well as a representative battery temperature measured at the negative terminal. Per IEEE 1188:2005, a representative minimum of 10% of the battery temperatures are to be averaged to develop the average battery temperature that will be used with the temperature correction factor provided within this document. Form in Appendix B “Refresh Record Form” can be used to record the requested data.

NOTE: There shall be no discharges of any duration between the start of the equalization and the completion of the float period. If a discharge does occur, the charging regime detailed above shall be repeated.

Upon completion of the charge, the desired acceptance or performance test can be performed per the following guidelines in conjunction with IEEE-1188.

1. IEEE 1188-2005 states “The discharge rate(s) and test length and their duration(s) should correspond as closely as is practical to the battery duty cycle.” Prior to discharging the battery, the desired discharge rate should be within East Penn published ratings, end voltage & temperature. Anything outside of these values shall be reviewed by East Penn Reserve Power’s Product Support Department.

2. It is important to ensure all connectors and cables are sized correctly to support the discharge rating. Improper connectors and cable sizing can cause excessive temperature to rise, and excessive voltage drop. This can significantly impact expected runtimes and battery life expectancy. Record individual battery voltages during the discharge. Be sure to record the time at which each battery drops below the design’s average end voltage if this occurs during the test.
3. If a DC load bank is used, be sure to disconnect the battery string from the UPS charger/load circuit. If an AC load bank is used, be sure to connect the load bank to the UPS system prior to discharge. Be sure to calibrate the load bank to the desired discharge amp or watt setting while the UPS is operating from its’ power supply.
4. During the discharge, if an individual battery is approaching reversal of its polarity (i.e. – 0 volts), but the battery string terminal voltage has not reached its test limit (i.e. – 1.67 vpc), the test should be continued with the bad battery “jumped out” where feasible. Upon doing this, a new end voltage should be calculated based on the remaining batteries.
5. For discharges 1 hour or greater, capacity should be determined by the time adjustment method defined by IEEE-1188 according to the following formula:

$$\% \text{ Capacity } 77^{\circ}\text{F } (25^{\circ}\text{C}) = [T_a \times K_t \times 100] / T_s$$

Where:

T_a = Actual test time to the specified end voltage

T_s = Rated time to the specified end voltage

K_t = Temperature correction factor (Ref. Table 1)

Discharge tests designed for 1 hour with an average unit temperature of less than 77°F (25°C) should follow the procedure for discharges of less than 1 hour.

For discharges less than 1 hour, capacity should be determined by the rate adjustment method defined by IEEE-1188 according to the following formula %

$$\text{Capacity } 77^{\circ}\text{F } (25^{\circ}\text{C}) = [X_a \times K_c \times 100] / X_t$$

Where:

X_a = Actual rate used during discharge test

X_t = Published rate for actual time of discharge test to specified terminal or cell/unit voltage

K_c = Temperature correction factor (Ref. Table 2).

6. Upon completion of the acceptance or performance test, the battery system should be recharged at the normal float voltage of 13.50 volts per battery. Temperature compensation charging parameters shall be applied as detailed in “Voltage Compensation Chart” in Appendix C.

K_t Factor (Discharges ≥ 1 hr.)

Temperature		K _t Factor
°C	°F	
35.0	95	0.962
34.4	94	0.963
33.9	93	0.965
33.3	92	0.967
32.8	91	0.969
32.2	90	0.971
31.7	89	0.973
31.1	88	0.975
30.6	87	0.977
30.0	86	0.978
29.4	85	0.980
28.9	84	0.983
29.3	83	0.986
27.8	82	0.989
27.2	81	0.992
26.7	80	0.995
26.1	79	0.997
25.6	78	0.998
25.0	77	1.000
24.4	76	1.005
23.9	75	1.010
23.3	74	1.013
22.8	73	1.016

Temperature		K _t Factor
°C	°F	
22.2	72	1.019
21.7	71	1.022
21.1	70	1.026
20.6	69	1.033
20.0	68	1.034
19.4	67	1.038
18.9	66	1.043
18.3	65	1.047
17.8	64	1.052
17.2	63	1.056
16.7	62	1.060
16.1	61	1.065
15.6	60	1.070
15.0	59	1.073
14.4	58	1.026
13.9	57	1.080
13.3	56	1.083
12.8	55	1.087
12.2	54	1.094
11.7	53	1.101
11.1	52	1.109
10.6	51	1.116
10.0	50	1.124

K_c Factor (Discharges ≤ 1 hr.)

Temperature		K _c Factor
°C	°F	
35.0	95	0.926
34.4	94	0.929
33.9	93	0.933
33.3	92	0.936
32.8	91	0.940
32.2	90	0.943
31.7	89	0.947
31.1	88	0.951
30.6	87	0.954
30.0	86	0.958
29.4	85	0.962
28.9	84	0.966
29.3	83	0.971
27.8	82	0.976
27.2	81	0.980
26.7	80	0.985
26.1	79	0.990
25.6	78	0.995
25.0	77	1.000
24.4	76	1.005
23.9	75	1.010
23.3	74	1.018
22.8	73	1.027

Temperature		K _c Factor
°C	°F	
22.2	72	1.035
21.7	71	1.044
21.1	70	1.053
20.6	69	1.062
20.0	68	1.071
19.4	67	1.080
18.9	66	1.089
18.3	65	1.099
17.8	64	1.109
17.2	63	1.119
16.7	62	1.129
16.1	61	1.139
15.6	60	1.149
15.0	59	1.163
14.4	58	1.176
13.9	57	1.190
13.3	56	1.205
12.8	55	1.220
12.2	54	1.232
11.7	53	1.244
11.1	52	1.256
10.6	51	1.269
10.0	50	1.282

APPENDIX G

EU DIRECTIVE 2023 / 1542 ARTICLE 10

To comply with Article 10 of EU Directive 2023 / 1542 the below information is required for any battery that has a rating ≥ 2 kWh.

Part A Battery Type

Rated Capacity	8 hr to 1.75 Vpc	Ah
		W/C
		kWh
Capacity Fade		%
Power Fade		%
Internal Resistance		Ohms
Internal Resistance Increase		%
Energy Round Trip Efficiency		%
Energy Round Trip Efficiency Fade		%
Design Life		(yrs)

12AVR170ET 12AVR200ET

170	200
42.1	49.5
2.0	2.4
N/A ¹	N/A ¹
N/A ¹	N/A ¹
0.00481	0.00305
N/A ¹	N/A ¹
80	80
N/A ¹	N/A ¹
10	10

Part B

Discharge Rate	
Charge Rate	
Ratio W vs Wh	
DoD	%
Power Capacity (kWh)	20%
	80%

C8	C8
C5	C5
8	8
N/A ¹	N/A ¹
.40	0.47
1.6	1.9

N/A¹ - required information does not exist for referenced batteries.



e-mail: reservepowersales@dekabatteries.com

